


6"x6" OR 4"x4" REDWOOD POST
WITH NECESSARY INFORMATION
TO BE ROUTED INTO MARKER POST

M.H. OBJECT (GATE VALVE)

10' DISTANCE TO OBJECT

2" HIGH ROUTED CAPITAL
LETTERS TO FACE OBJECT.

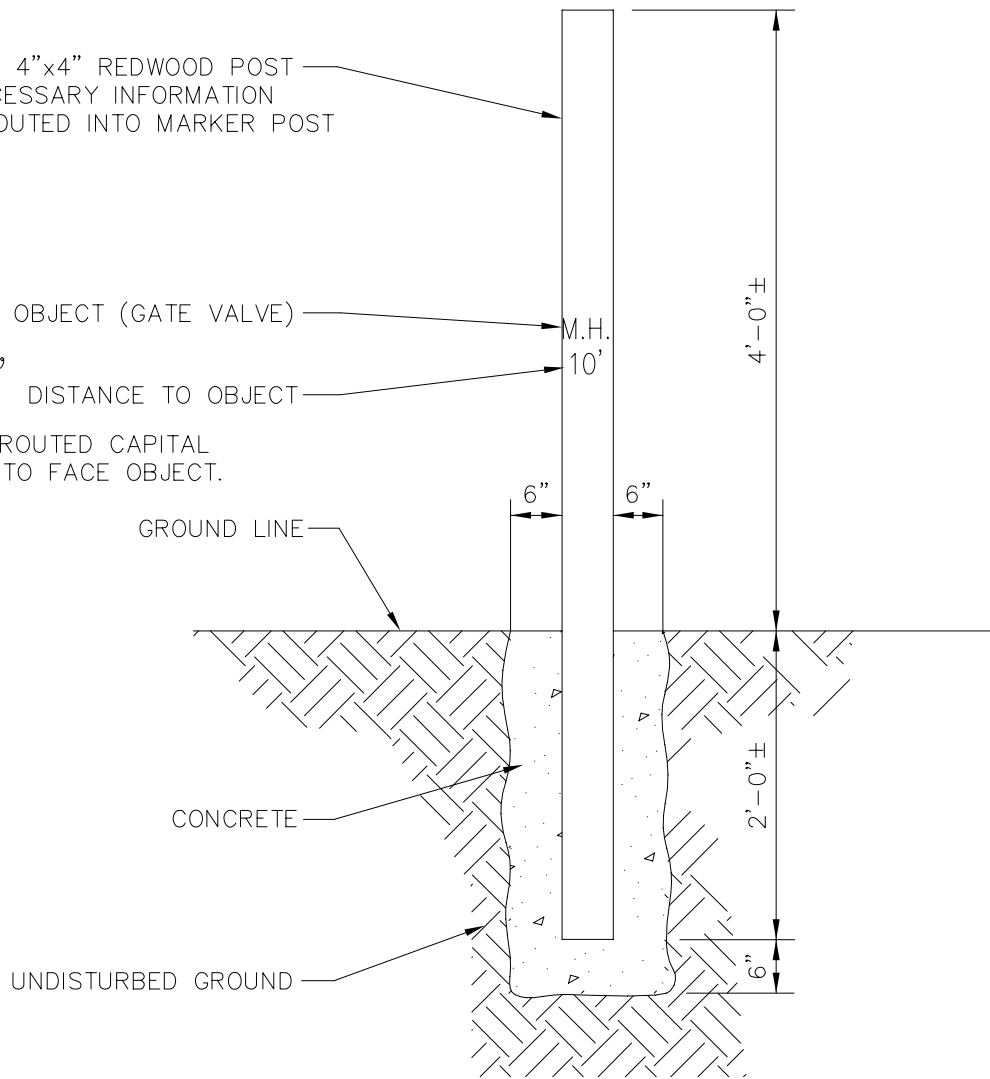

DATE
7/2007



PLATTE CANYON
WATER & SANITATION DISTRICT

DRAWING
D.18S

REDWOOD MARKER
POST