


18" FIBER MESH CONCRETE COLLAR, 1" BELOW RIM AND SLOPED AWAY FROM MH (IN FIELD)

24"DIA-8"H, CAST IRON RING AND COVER, SEE MH COVER DETAIL FOR ADDITIONAL SIZING

2' DIA PRECAST CONC ADJUSTMENT RINGS SET IN FLEXIBLE BUTYL RUBBER CAULKING, USE FULL HEIGHT RINGS

FINISHED PAVEMENT PER GOVERNING AUTHORITY

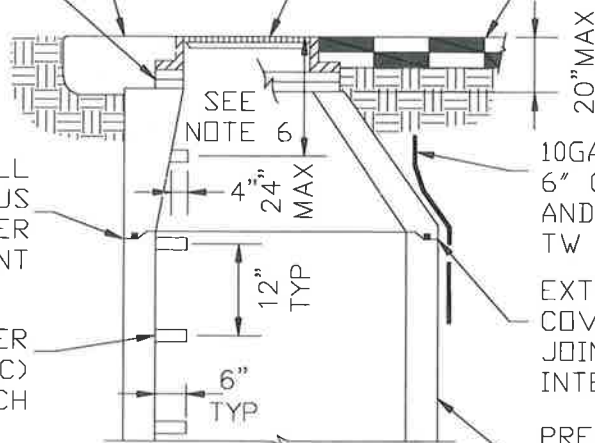

EACH PRECAST RISER SHALL BE SET IN A CONTINUOUS BED OF BUTYL RUBBER SEALANT


10GA TRACE WIRE INTO 6" CI SHORT VALVE BOX AND FDN. SEE TYPICAL TW PLACEMENT DETAIL

MANHOLE STEPS (COPOLYMER POLYPROPYLENE PLASTIC) PLACED OVER BENCH

EXTERIOR JOINTS TO BE COVERED IN 12" WIDE JOINT WRAP, GROUT INTERIOR JOINTS

MANHOLE BASE SHALL BE POURED AROUND THE PIPE WITH NECESSARY INVERTS, WATER STOP GASKETS AND BENCHES, PIPE SHALL PROTRUDE 4" MIN WITHIN THE MANHOLE

PRECAST RISER AND ECCENTRIC CONE (ASTM C478)

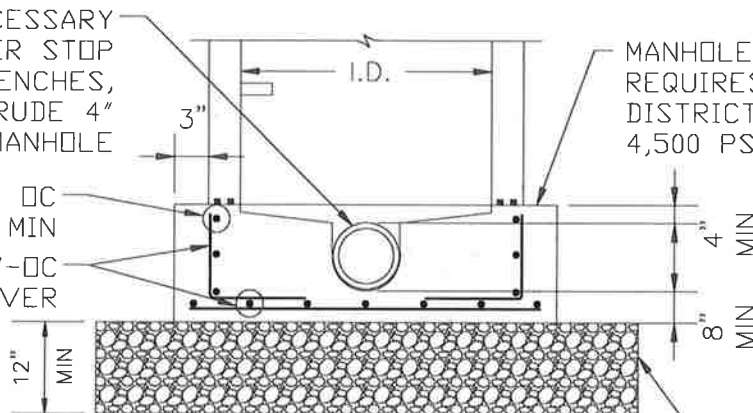

MANHOLE CIP BASE REQUIRES PRIOR DISTRICT APPROVAL 4,500 PSI MIN CONCRETE

#4 RINGS @ 12" OC
3 RINGS MIN
#4 @ 12" EW-OC
MIN 3" COVER

NOTES:

1. ALL PRECAST CONCRETE SHALL BE WET CAST, 6,000 PSI MINIMUM STRENGTH.
2. MANHOLES ARE TO BE WATERPROOF.
3. PRECAST MANHOLE WILL REQUIRE AN EXTERIOR COATING OF WATERPROOFING.
4. THE BENCH SHALL HAVE A BRUSHED SURFACE AND A FULL DEPTH CHANNEL.
5. A TWO-SIDED CONFINED SPACED WARNING TAG SHALL BE ATTACHED TO THE TOP STEP.

MANHOLE ID:

- ID=4' FOR SEWER MAIN DIAMETERS < 15"
 - ID=5' FOR SEWER MAIN DIAMETERS 15"-36"
 - ID=6' FOR SEWER MAIN DIAMETERS 42"-48"
- WHENEVER MORE THAN A TWO WAY MH OF MAX PIPE IS REQUIRED, THE MH SHALL BE INCREASED TO THE LARGER DIAMETER SIZE

DATE
10/25/2019



PLATTE CANYON
WATER & SANITATION DISTRICT

DRAWING
D.7S

**PRECAST MANHOLE
CAST-IN-PLACE BASE
DETAIL**