

# PLATTE CANYON WATER AND SANITATION DISTRICT

## FACILITY OWNERSHIP STATISTICAL REPORT YEAR ENDING DECEMBER 31, 2020

### Water

Miles of Water Main Installed in 2020	0.91
No. of Isolation Valves Installed in 2020	25
No. of Blow-off Valves Installed in 2020	0
No. Fire Hydrants Installed in 2020	8
Miles of Water Main in System as of 12/31/2020	77.48
No. of Isolation Valves in system as of 12/31/2020	1,223
No. of Blow-off Valves in System as of 12/31/2020	132
No. of Fire Hydrants in System as of 12/31/2020	494

### Sewer

Miles of Sewer Main Installed in 2020	0.00
Miles of Sewer Main in System as of 12/31/2020	75.98
No. of Manholes as of 12/31/2020	1,903
No. of Cleanouts as of 12/31/2020	11

# FACILITY OWNERSHIP STATISTICAL REPORT

## YEAR ENDING DECEMBER 31, 2020

### WATER FACILITIES

<u>Size</u>	<u>Type</u>	<u>Total</u> <u>12/31/2019</u>	<u>Add</u>	<u>Subtract</u>	<u>Total</u> <u>12/31/2020</u>
<b>PIPE:</b>					
4"	ACP	1,342			1,342
4"	CIP	3,053			3,053
4"	PVC	4,088			4,088
6"	ACP	122,489		47	122,442
6"	CIP	27,459		3,583	23,876
6"	DIP	819			819
6"	PVC	35,239	21	61	35,199
8"	ACP	54,968			54,968
8"	CIP	15,633		1,178	14,455
8"	DIP	9,161			9,161
8"	PVC	61,802	3,550		65,352
10"	ACP	740			740
10"	CIP	684			684
10"	DIP	253			253
12"	ACP	37,061			37,061
12"	CIP	6,178			6,178
12"	DIP	3,748			3,748
12"	PVC	4,041	1,211		5,252
16"	CIP	1,691			1,691
16"	DIP	7,067			7,067
16"	PVC	1,082			1,082
16"	STL	2,217			2,217
18"	STL	8,351			8,351
	<b>TOTAL</b>	<b>409,166</b>	<b>4,782</b>	<b>4,868</b>	<b>409,079</b>

ACP: Asbestos Cement Pipe  
PVC: Polyvinyl Chloride Pipe  
CIP: Cast Iron Pipe  
DIP: Ductile Iron Pipe  
STL: Steel Pipe

# FACILITY OWNERSHIP STATISTICAL REPORT

## YEAR ENDING DECEMBER 31, 2020

### WATER FACILITIES(continued)

<u>Size</u>	<u>Type</u>	<u>Total</u> <u>12/31/2019</u>	<u>Add</u>	<u>Subtract</u>	<u>Total</u> <u>12/31/2020</u>
<b>VALVES:</b>					
2"	PRV	1			1
4"	Gate	25			25
4"	PRV	3			3
6"	Gate	487	11	11	487
6"	PRV	3			3
8"	Gate	493	14	6	501
8"	PRV	1			1
10"	Gate	10			10
10"	PRV	3			3
12"	Gate	179			179
16"	Gate	1			1
16"	Butterfly	6		2	4
16"	Check	1			1
18"	Butterfly	4			4
	TOTAL	1,217	25	19	1,223
<b>BLOW-OFFS:</b>					
2"	Ball	75			75
2"	Gate	57			57
	TOTAL	1554	0	0	132
<b>HYDRANTS:</b>					
6"	Mueller Cent.	131	8	5	134
6"	Mueller Im.	46		2	44
6"	Waterous	306			306
6"	Amer. Darling	5			5
6"	Kennedy	5			5
	TOTAL	493	8	7	494

# FACILITY OWNERSHIP STATISTICAL REPORT

## YEAR ENDING DECEMBER 31, 2020

### SEWER FACILITIES

<u>Size</u>	<u>Type</u>	<u>Total</u> <u>12/31/2019</u>	<u>Add</u>	<u>Subtract</u>	<u>Total</u> <u>12/31/2020</u>
<b>PIPE:</b>					
6"	VCP	150			150
8"	CP	215			215
8"	VCP	229,011			229,011
8"	PVC	83,093			83,093
8"	C-900	506			506
8"	CPP	28,354			28,354
8"	CIP	223			223
8"	DIP	84			84
8"	PEP	2,574			2,574
10"	VCP	17,542			17,542
10"	PVC	2,708			2,708
10"	CPP	4,307			4,307
12"	VCP	950			950
12"	CPP	900			900
15"	PVC	3,452			3,452
15"	CP	200			200
16"	PEP	746			746
16"	PVC	293			293
16"	SRC	2,698			2,698
18"	CPP	4,803			4,803
18"	PEP	4,928			4,928
21"	CPP	1,577		264	1,313
22"	PEP	4,195			4,195
24"	PEP	3,712			3,712
24"	PVC	50			50
24"	CPP	4,007			4,007
30"	CPE	186			186
	<b>TOTAL</b>	<b>401,464</b>	<b>0</b>	<b>264</b>	<b>401,200</b>

CP: Concrete Pipe  
VCP: Vitrified Clay Pipe  
PVC: Polyvinyl Chloride Pipe  
C-900: Polyvinyl Chloride Pipe C-900 Class 200  
CPP: Cured In-place Pipe

PEP: Polyethylene Pipe  
CIP: Cast Iron Pipe  
DIP: Ductile Iron Pipe  
RCP: Reinforced Concrete Pipe

# PLATTE CANYON WATER AND SANITATION DISTRICT

## WATER & SEWER SUPPLY REPORT YEAR ENDING DECEMBER 31, 2020

### Taps

Water Taps Sold in 2020	0
3/4" Equivalent Water Taps Sold in 2020	0
Sewer Taps Sold in 2020	6
Single Family Equivalent Sewer Taps Sold in 2020	16

### Consumption

Total Water Delivered (gallons)	956,169,000
---------------------------------	-------------



## WATER & SEWER SUPPLY REPORT - (2011-2020)

	<u>2020</u>	<u>2019</u>	<u>2018</u>	<u>2017</u>	<u>2016</u>	<u>2015</u>	<u>2014</u>	<u>2013</u>	<u>2012</u>	<u>2011</u>
<b>SEWER TAPS:</b>										
Total Active Taps	6,844.00	6,838.00	6,832.00	6,823.00	6,821.00	6,821.00	6,818.00	6,812.00	6,802.00	6,799.00
Single Family Residential	5,812.00	5,806.00	5,797.00	5,796.00	5,796.00	5,793.00	5,789.00	5,782.00	5,779.00	5,778.00
Multi Family Residential	913.00	913.00	913.00	913.00	913.00	913.00	913.00	913.00	913.00	913.00
Commercial	119.00	119.00	119.00	118.00	118.00	118.00	116.00	113.00	113.00	113.00
Taps Sold	6.00	6.00	9.00	2.00	0.00	3.00	6.00	10.00	3.00	1.00
Single Family Residential	5.00	6.00	9.00	1.00	0.00	3.00	4.00	7.00	3.00	1.00
Multi Family Residential	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Commercial	1.00	0.00	0.00	1.00	0.00	0.00	2.00	3.00	0.00	0.00
Total Single Family Equiv.	7,316.87	7,310.87	7,301.87	7,299.87	7,299.87	7,296.87	7,290.87	7,250.87	7,247.87	7,246.87
Single Family Residential	5,801.00	5,795.00	5,786.00	5,785.00	5,785.00	5,782.00	5,778.00	5,771.00	5,768.00	5,767.00
Multi Family Residential	913.00	913.00	913.00	913.00	913.00	913.00	913.00	913.00	913.00	913.00
Commercial	602.87	602.87	602.87	601.87	601.87	601.87	599.87	566.87	566.87	566.87
Single Family Equiv. Sold	16.00	6.00	9.00	2.00	0.00	3.00	6.00	40.00	3.00	1.00
Single Family Residential	5.00	6.00	9.00	1.00	0.00	3.00	4.00	7.00	3.00	1.00
Multi Family Residential	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Commercial	11.00	0.00	0.00	1.00	0.00	0.00	2.00	33.00	0.00	0.00
<b>CONSUMPTION:</b>										
Total Water Delivered*	956,169.00	797,885.00	859,815.00	848,648.00	863,376.00	786,955.00	782,242.00	831,457.00	1,064,104.00	917,049.00
Gal./3/4" Equivilant/Day	392.99	328.13	353.60	349.06	355.11	323.78	321.89	342.29	438.46	378.04
Gal./Capita/Day	134.13	112.03	120.89	119.34	121.41	110.72	110.12	117.18	150.04	129.32
Gal./Account/Day	445.37	371.64	400.76	395.55	402.49	366.86	364.73	387.74	496.48	428.31
Single Family Res. - Delivered*	840,289.00	691,921.00	745,418.00	713,707.00	742,053.00	673,120.00	639,311.00	684,710.00	875,935.00	757,473.00
Gal./3/4" Equivilant/Day	395.36	325.77	350.96	336.09	349.44	317.08	301.21	322.77	413.33	357.62
Gal./Account/Day	409.78	337.67	363.78	348.36	362.20	328.61	312.16	334.51	428.39	370.65
Multit-Family Res. - Delivered*	53,656.00	29,936.00	41,555.00	26,615.00	31,369.00	50,821.00	54,527.00	57,565.00	70,011.00	55,835.00
Gal./3/4" Equivilant/Day	375.97	209.76	291.17	186.49	219.80	356.10	382.07	403.36	490.57	391.23
Gal./Account/Day	973.53	543.16	753.97	482.90	569.16	922.09	989.33	1,044.45	1,270.27	1,013.06
Commercial - Delivered*	62,224.00	76,028.00	72,842.00	108,326.00	89,954.00	63,014.00	88,404.00	89,182.00	118,158.00	103,741.00
Gal./3/4" Equivilant/Day	377.16	460.83	441.52	656.60	545.24	381.95	535.85	540.56	716.20	628.81
Gal./Account/Day	1,508.64	1,843.33	1,766.08	2,626.40	2,180.97	1,527.80	2,143.39	2,162.25	2,864.78	2,515.24

\*in thousands of gallons

## WATER & SEWER SUPPLY REPORT - (2011-2020)


<b>FACILITY:</b>	<u>2020</u>	<u>2019</u>	<u>2018</u>	<u>2017</u>	<u>2016</u>	<u>2015</u>	<u>2014</u>	<u>2013</u>	<u>2012</u>	<u>2011</u>
<b>Water</b>										
Distribution Mains*	77.48	77.48	77.46	77.46	77.46	77.46	77.36	77.36	77.32	77.04
Insatlled (new)**	0.00	79.00	0.00	0.00	0.00	561.00	0.00	198.00	1,492.00	0.00
Installed (replaced)**	4,868.33	3,208.00	149.00	0.00	1,120.00	0.00	0.00	1,425.00	1,045.00	1,491.00
No. Water Main Breaks	14	11	21	10	7	13	8	9	9	11
Valves Op. & Serv.	1,198	1,180	1,186	1,191	1,190	1,190	1,187	1,169	1,180	1,179
Distribution Main Flushing	193	199	199	194	197	161	159	29	159	158
Hydrants Op. Serv.	489	491	491	463	491	491	491	490	490	490
<b>Sewer</b>										
Collection Mains	70.83	70.88	70.88	70.88	70.65	70.65	70.54	70.54	70.54	70.54
Installed (new)**	-264.00	0.00	0.00	1,233.00	0.00	609.00	0.00	0.00	0.00	0.00
Installed (replaced)**	264.00	12,621.00	2,969.00	0.00	0.00	0.00	0.00	200.00	300.00	0.00
Interceptor Mains*	5.15	5.15	5.82	5.82	5.82	5.82	5.82	5.82	5.82	5.82
No. Sewer Backups	0.00	0.00	1.00	0.00	1.00	1.00	0.00	0.00	0.00	0.00
Main Televised**	129,778	77,009	101,240.00	102,785.00	120,282.00	80,391.00	97,123.00	110,365.00	103,517.00	70,560.00
Main Hyd. Cleaned**	57,754	78,338	102,227.00	48,674.00	31,751.00	41,023.00	53,422.00	36,586.00	36,240.00	39,287.00
Main Root Cut**	87,324	44,974.00	40,371.00	63,506.00	73,002.00	50,151.00	50,768.00	80,586.00	82,924.00	91,467.00
Main Root Treated**	9,725	14,529.00	16,166.00	13,353.00	20,851.00	12,578.00	14,058.00	14,797.00	9,851.00	0.00
<b>ADMINISTRATION:</b>										
No. Full Time Equivalent	12.70	12.12	12.26	12.08	11.97	10.94	11.34	10.73	10.66	10.79
Total Hours Worked	26,422.00	25,208.16	25,495.00	25,136.00	24,891.00	22,745.00	23,590.00	22,324.00	22,170.00	22,444.00
Total Hours Worked(PC)	10,676.00	9,839.48	10,808.00	9,935.00	9,156.00	8,569.00	9,213.00	9,021.00	9,404.00	9,096.00
Administration	6,688.00	5,942.92	6,306.00	5,347.00	4,746.00	4,115.00	5,189.00	4,704.00	4,874.00	4,786.00
Maintenance	3,988.00	3,896.56	4,502.00	4,588.00	4,410.00	4,454.00	4,024.00	4,317.00	4,530.00	4,310.00
Total Hours Worked(SWM)	13,086.00	13,191.18	12,294.00	12,681.00	12,941.00	12,085.00	12,419.00	11,707.00	11,012.00	11,746.00
Administration	6,618.00	5,824.41	5,615.00	5,359.00	6,113.00	4,470.00	6,071.00	4,967.00	4,869.00	4,939.00
Maintenance	6,468.00	7,366.77	6,679.00	7,322.00	6,828.00	7,615.00	6,348.00	6,740.00	6,143.00	6,807.00
Total Hours Worked(Others)	2,660.00	2,177.50	2,393.00	2,520.00	2,794.00	2,091.00	1,958.00	1,596.00	1,754.00	1,602.00
Administration	1,170.00	834.75	871.00	1,201.00	1,047.00	1,255.00	617.00	423.00	300.00	282.00
Maintenance	1,490.00	1,342.75	1,522.00	1,319.00	1,747.00	836.00	1,341.00	1,173.00	1,454.00	1,320.00

\* miles  
 \*\* feet



# PLATTE CANYON W&S DISTRICT

## Water Pipe Installed By Year

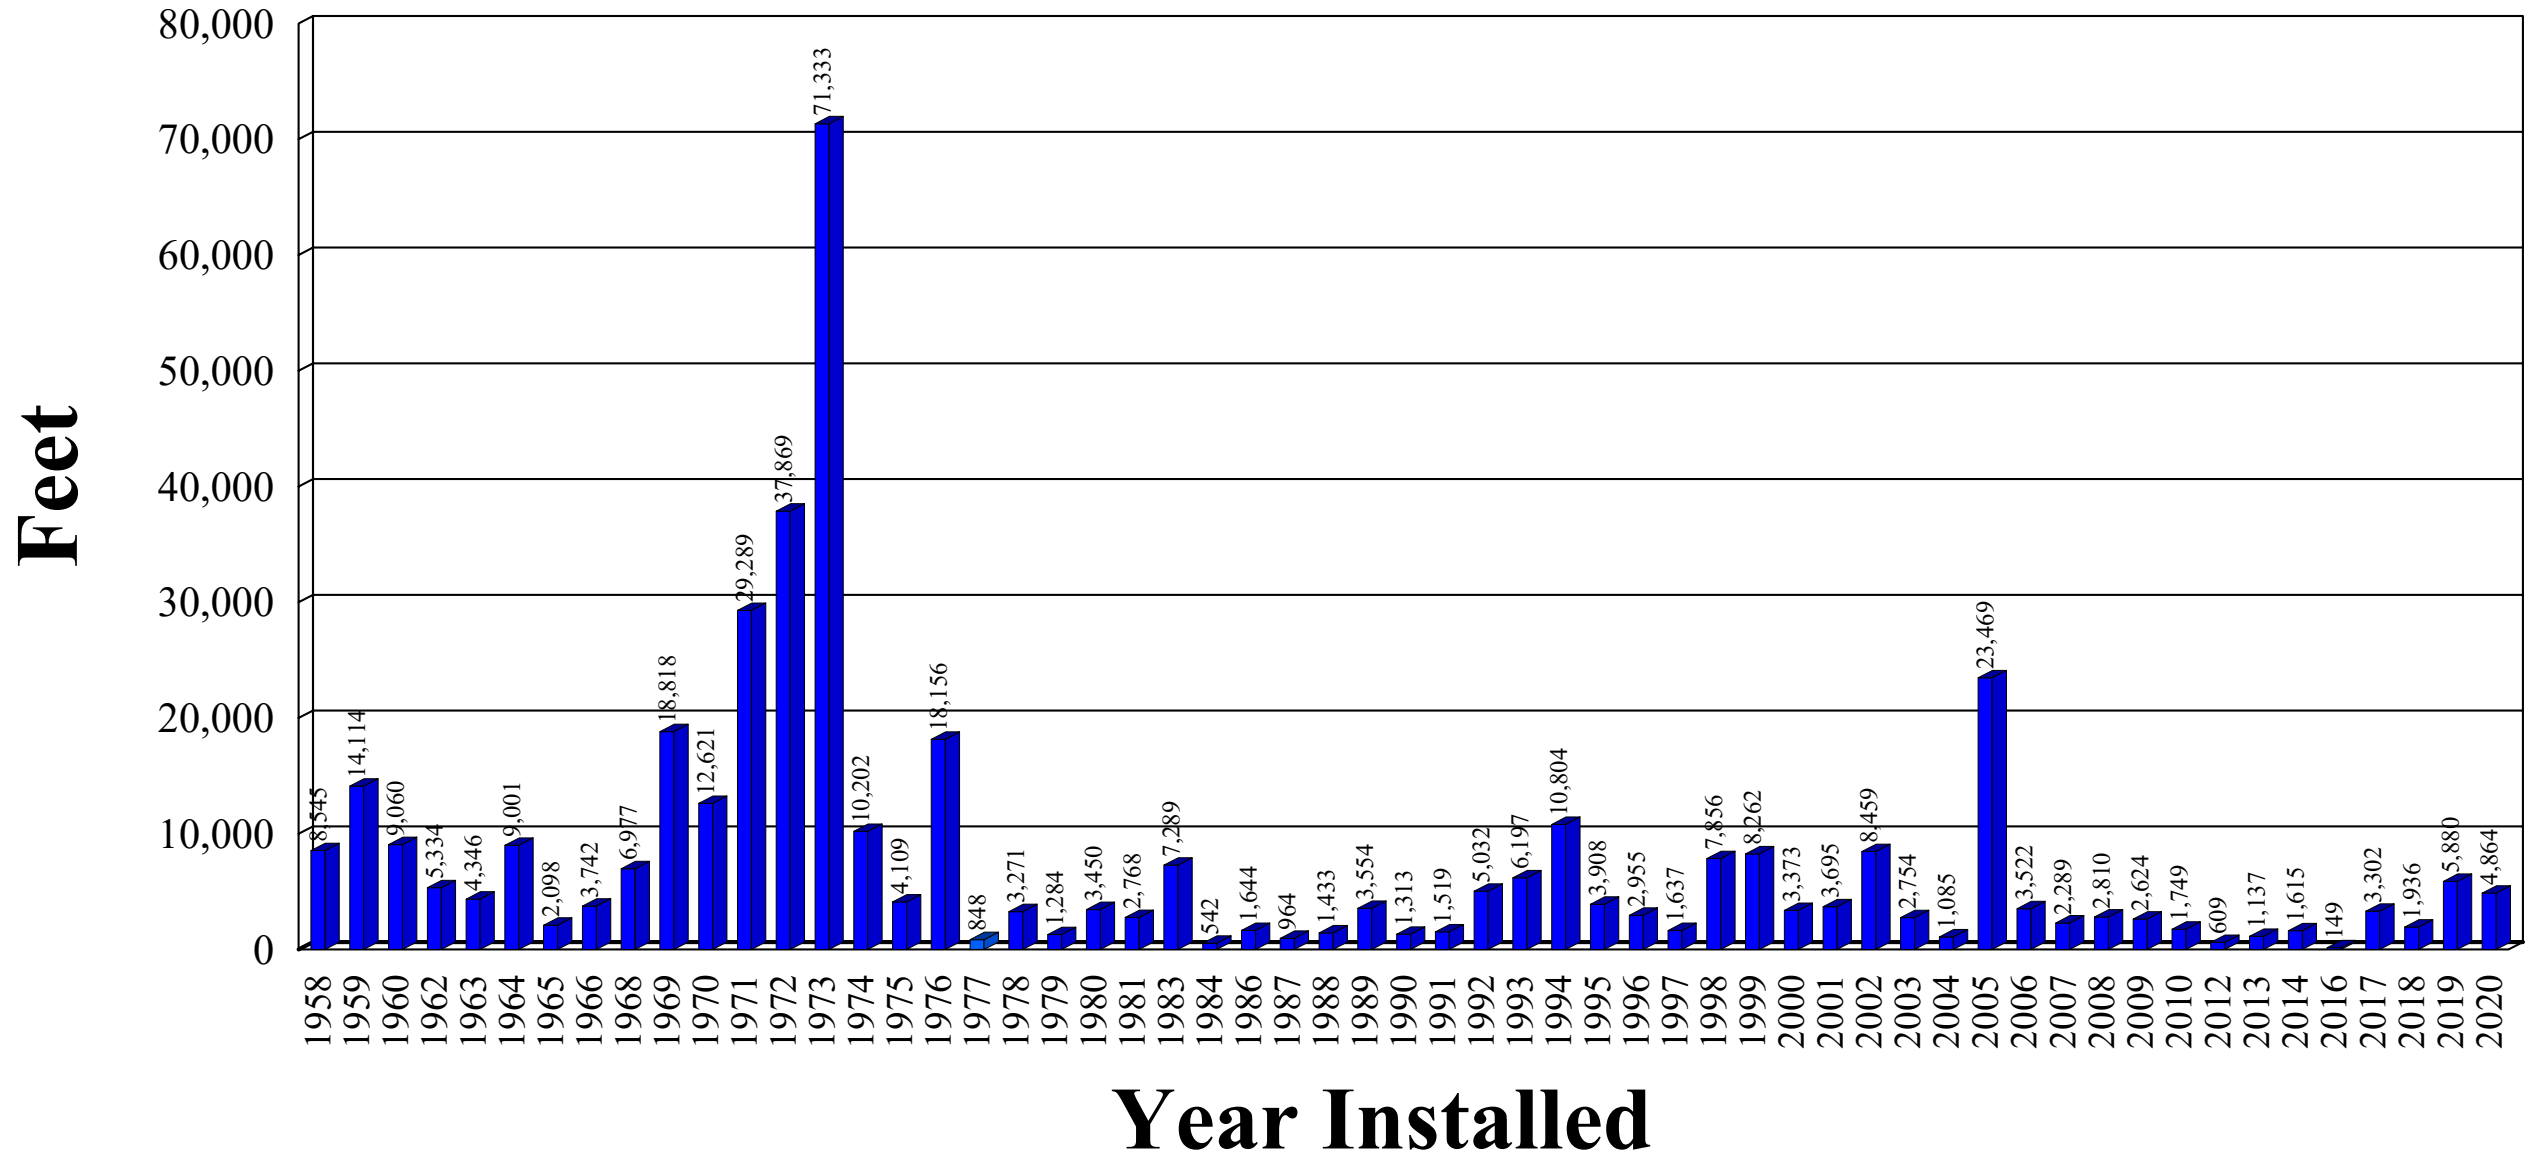




	4			6				8				10			12				16				18		Total
	ASBESTOS CEMENT PIPE	CAST IRON PIPE	POLYVINYL CHLORIDE PIPE	ASBESTOS CEMENT PIPE	CAST IRON PIPE	DUCTILE IRON PIPE	POLYVINYL CHLORIDE PIPE	ASBESTOS CEMENT PIPE	CAST IRON PIPE	DUCTILE IRON PIPE	POLYVINYL CHLORIDE PIPE	ASBESTOS CEMENT PIPE	CAST IRON PIPE	DUCTILE IRON PIPE	ASBESTOS CEMENT PIPE	CAST IRON PIPE	DUCTILE IRON PIPE	POLYVINYL CHLORIDE PIPE	CAST IRON PIPE	DUCTILE IRON PIPE	POLYVINYL CHLORIDE PIPE	STEEL PIPE	DUCTILE IRON PIPE	STEEL PIPE	
1979	0	0	0	522	0	31	0	732	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1,284
1980	0	0	0	0	0	68	0	0	0	2,213	0	0	0	0	0	0	1,168	0	0	0	0	0	0	0	3,450
1981	0	0	0	2,243	0	135	0	1	118	64	0	0	0	0	0	0	208	0	0	0	0	0	0	0	2,768
1983	0	0	0	194	0	305	0	2,393	0	660	0	0	0	0	3,160	0	576	0	0	0	0	0	0	0	7,289
1984	0	0	0	0	0	0	0	0	0	542	0	0	0	0	0	0	0	0	0	0	0	0	0	0	542
1986	0	0	0	0	0	31	0	0	0	0	1,613	0	0	0	0	0	0	0	0	0	0	0	0	0	1,644
1987	0	0	0	0	0	15	949	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	964
1988	0	0	0	0	0	26	1,195	0	0	212	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1,433
1989	0	0	0	0	0	121	1,544	0	0	401	602	0	0	0	0	0	0	886	0	0	0	0	0	0	3,554
1990	0	0	0	0	0	51	0	0	0	0	1,262	0	0	0	0	0	0	0	0	0	0	0	0	0	1,313
1991	0	0	0	0	0	33	1,196	0	0	0	290	0	0	0	0	0	0	0	0	0	0	0	0	0	1,519
1992	0	0	0	0	0	163	703	0	0	2,150	1,835	0	0	181	0	0	0	0	0	0	0	0	0	0	5,032
1993	0	0	0	0	0	706	1,547	0	0	0	0	0	0	0	0	0	386	0	0	3,558	0	0	0	0	6,197
1994	0	0	0	0	0	144	491	0	0	1,048	6,215	0	0	0	0	0	1,020	0	0	0	0	0	0	1,886	10,804
1995	0	0	0	0	0	128	1,174	0	0	0	1,775	0	0	0	0	0	0	831	0	0	0	0	0	0	3,908
1996	0	0	0	0	0	394	0	0	0	997	0	0	0	0	0	0	1,564	0	0	0	0	0	0	0	2,955
1997	0	0	0	0	0	96	0	0	0	124	408	0	0	0	0	0	0	0	0	1,010	0	0	0	0	1,637
1998	0	0	0	0	0	318	3,979	0	0	12	3,488	0	0	46	0	0	13	0	0	0	0	0	0	0	7,856
1999	0	0	0	0	0	469	0	0	0	0	7,752	0	0	25	0	0	14	0	0	0	0	0	0	0	8,262
2000	0	0	368	0	0	391	41	0	0	0	1,594	0	0	0	0	0	0	0	0	979	0	0	0	0	3,373

	4			6				8				10			12				16				18		Total
	ASBESTOS CEMENT PIPE	CAST IRON PIPE	POLYVINYL CHLORIDE PIPE	ASBESTOS CEMENT PIPE	CAST IRON PIPE	DUCTILE IRON PIPE	POLYVINYL CHLORIDE PIPE	ASBESTOS CEMENT PIPE	CAST IRON PIPE	DUCTILE IRON PIPE	POLYVINYL CHLORIDE PIPE	ASBESTOS CEMENT PIPE	CAST IRON PIPE	DUCTILE IRON PIPE	ASBESTOS CEMENT PIPE	CAST IRON PIPE	DUCTILE IRON PIPE	POLYVINYL CHLORIDE PIPE	CAST IRON PIPE	DUCTILE IRON PIPE	POLYVINYL CHLORIDE PIPE	STEEL PIPE	DUCTILE IRON PIPE	STEEL PIPE	
2001	0	0	0	0	0	379	1,211	0	0	0	2,104	0	0	0	0	0	0	0	0	0	0	0	0	0	3,695
2002	0	0	0	0	0	308	1,701	0	0	0	6,449	0	0	0	0	0	0	0	0	0	0	0	0	0	8,459
2003	0	0	259	0	0	264	0	0	0	0	2,232	0	0	0	0	0	0	0	0	0	0	0	0	0	2,754
2004	0	0	0	0	0	270	815	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1,085
2005	0	0	2,477	0	0	681	3,917	0	0	30	14,998	0	0	0	0	0	0	0	0	1,366	0	0	0	0	23,469
2006	0	0	269	0	0	57	1,508	0	0	0	606	0	0	0	0	0	0	0	0	0	1,082	0	0	0	3,522
2007	0	0	0	0	0	109	1,414	0	0	0	766	0	0	0	0	0	0	0	0	0	0	0	0	0	2,289
2008	0	0	0	0	0	51	2,079	0	0	0	680	0	0	0	0	0	0	0	0	0	0	0	0	0	2,810
2009	0	0	0	0	0	70	564	0	0	0	1,421	0	0	0	0	0	0	569	0	0	0	0	0	0	2,624
2010	0	0	354	0	0	105	1,289	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1,749
2012	0	0	0	0	0	47	562	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	609
2013	0	0	361	0	0	16	0	0	0	0	760	0	0	0	0	0	0	0	0	0	0	0	0	0	1,137
2014	0	0	0	0	0	43	1,520	0	0	0	52	0	0	0	0	0	0	0	0	0	0	0	0	0	1,615
2016	0	0	0	0	0	0	149	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	149
2017	0	0	0	0	0	55	2,963	0	0	0	5	0	0	0	0	0	112	0	0	155	0	0	12	0	3,302
2018	0	0	0	0	0	25	1,720	0	0	0	0	0	0	0	0	0	191	0	0	0	0	0	0	0	1,936
2019	0	0	0	0	0	52	948	0	0	0	4,879	0	0	0	0	0	0	0	0	0	0	0	0	0	5,880
2020	0	0	0	0	0	82	21	0	0	0	3,550	0	0	0	0	0	0	1,211	0	0	0	0	0	0	4,864
<b>Total</b>	<b>1,342</b>	<b>3,053</b>	<b>4,088</b>	<b>122,514</b>	<b>23,876</b>	<b>9,116</b>	<b>35,199</b>	<b>54,968</b>	<b>14,455</b>	<b>9,161</b>	<b>65,352</b>	<b>740</b>	<b>684</b>	<b>253</b>	<b>37,061</b>	<b>6,178</b>	<b>3,748</b>	<b>5,253</b>	<b>1,691</b>	<b>7,068</b>	<b>1,082</b>	<b>2,217</b>	<b>12</b>	<b>8,351</b>	<b>417,463</b>

# PLATTE CANYON W&S DISTRICT

## Sewer Pipe Installed By Year

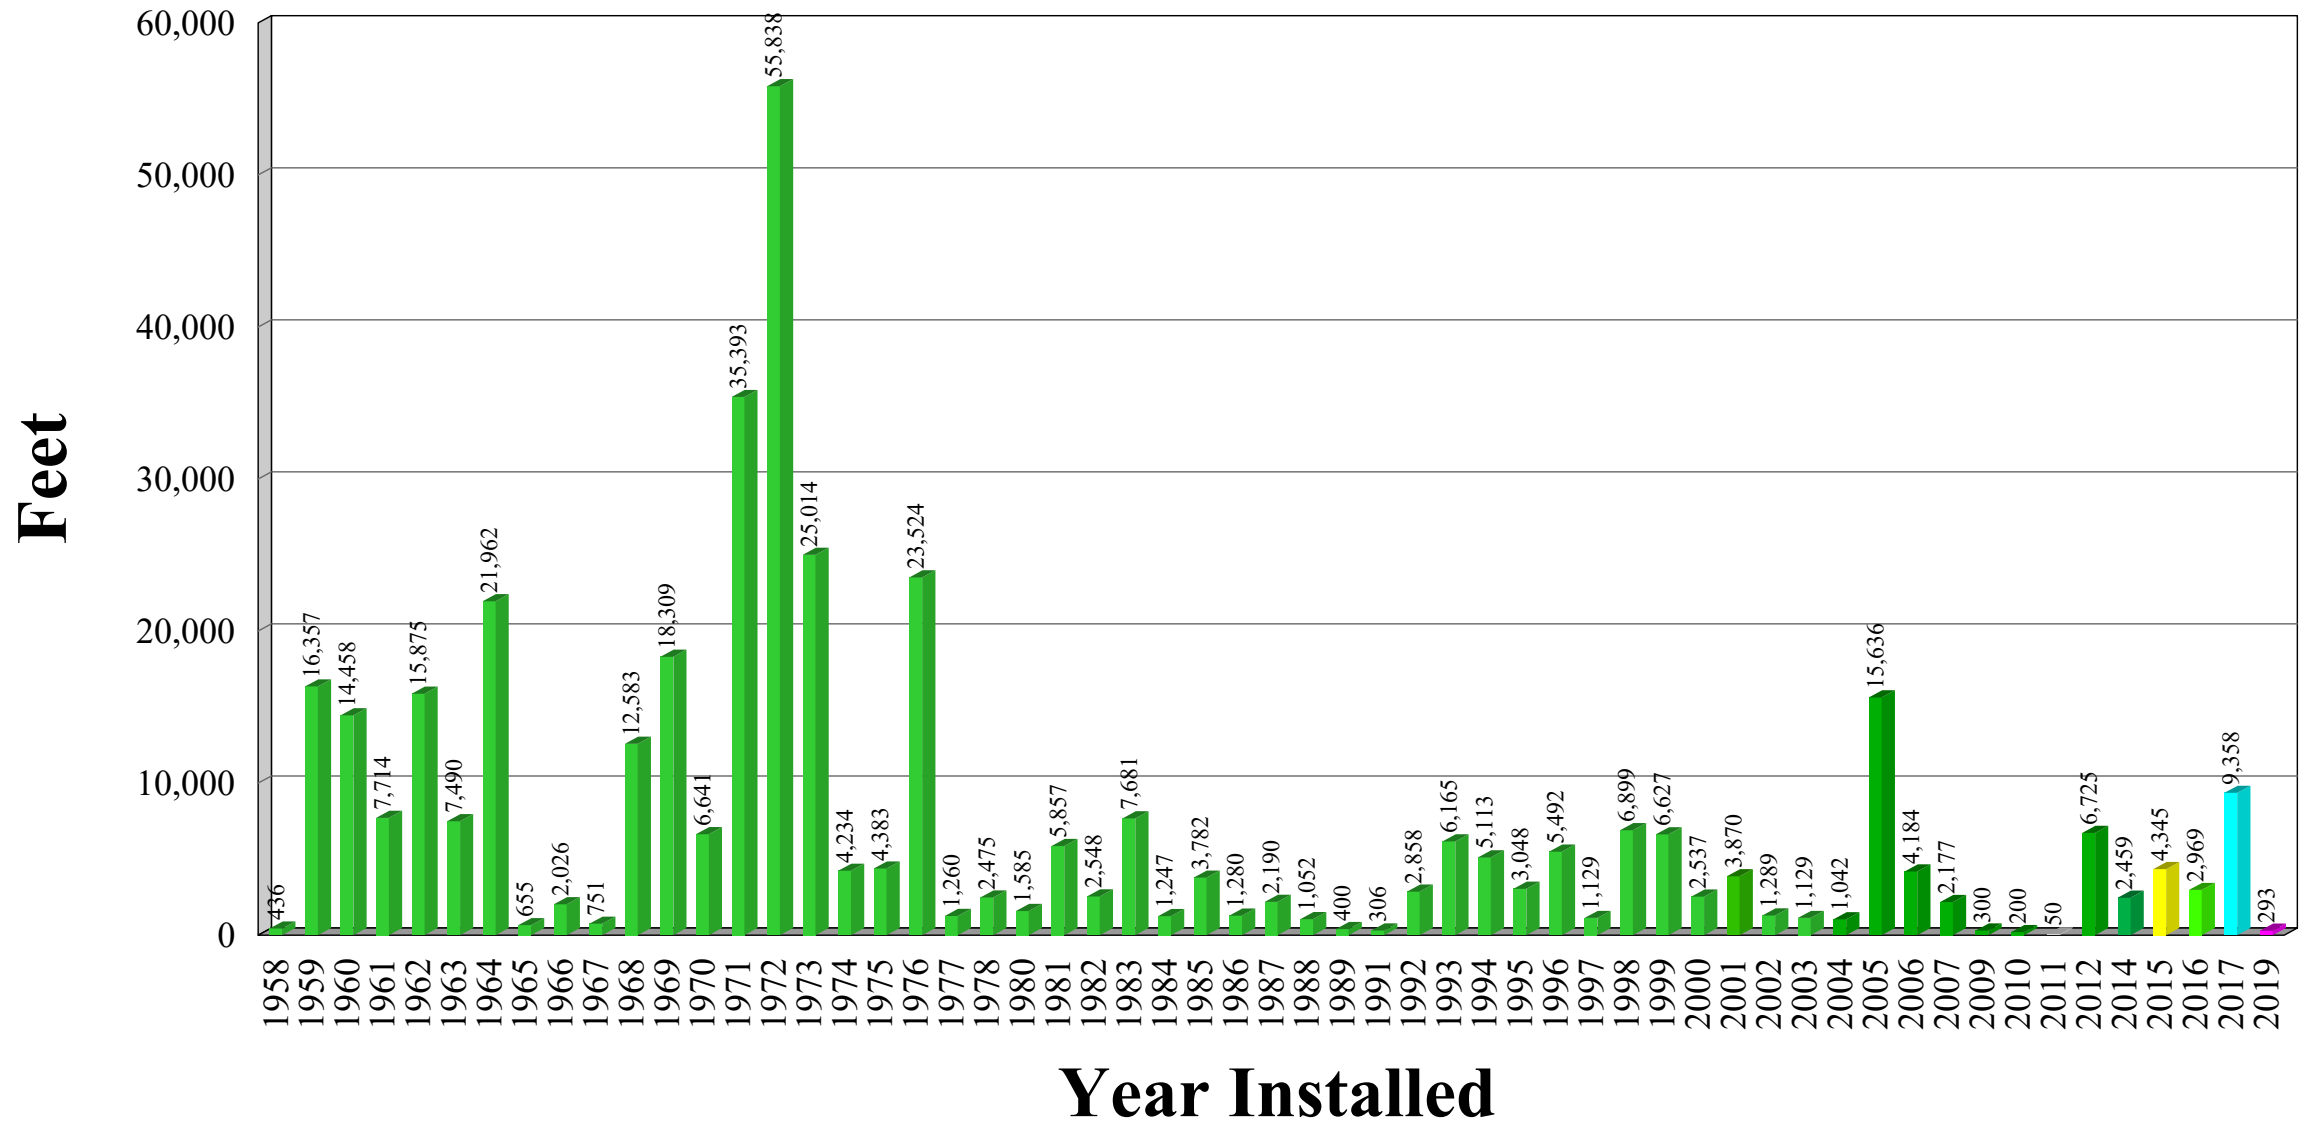

# Sewer Pipe Installed By Year

	6	8								10			12		15		16			18		21	22	24			30	Total	
	Vitrified Clay Pipe	C-900 POLYVINYL CHLORIDE PIPE	CAST IRON PIPE	Concrete Pipe (non-reinforced)	CURED IN PLACE PIPE	Ductile Iron Pipe	Polyvinyl Chloride	SLIPLINED VITRIFIED CLAY PIPE	Vitrified Clay Pipe	CURED IN PLACE PIPE	Polyvinyl Chloride	Vitrified Clay Pipe	CURED IN PLACE PIPE	Vitrified Clay Pipe	Concrete Pipe (non-reinforced)	Polyvinyl Chloride	POLYETHYLENE PIPE	Polyvinyl Chloride	SLIPLINED REINFORCED CONCRETE PIPE	CURED IN PLACE PIPE	SLIPLINED REINFORCED CONCRETE PIPE	CURED IN PLACE PIPE	SLIPLINED REINFORCED CONCRETE PIPE	CURED IN PLACE PIPE	Polyvinyl Chloride	SLIPLINED REINFORCED CONCRETE PIPE	CURED IN PLACE PIPE		SPRIPOLITE POLYETHYLENE PIPE
1958	0	0	0	0	0	0	0	0	436	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	436
1959	0	0	0	215	0	0	0	0	15,992	0	0	150	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	16,357
1960	150	0	0	0	0	0	0	0	12,305	0	0	1,460	0	543	0	0	0	0	0	0	0	0	0	0	0	0	0	0	14,458
1961	0	0	0	0	0	0	0	0	4,566	0	0	2,741	0	407	0	0	0	0	0	0	0	0	0	0	0	0	0	0	7,714
1962	0	0	0	0	0	0	0	0	15,169	0	0	706	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	15,875
1963	0	0	0	0	0	0	0	0	7,490	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	7,490
1964	0	0	0	0	0	0	0	0	20,106	0	0	1,856	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	21,962
1965	0	0	0	0	0	0	0	0	655	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	655
1966	0	0	0	0	0	0	0	0	2,026	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2,026
1967	0	0	0	0	0	0	0	0	751	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	751
1968	0	0	0	0	0	0	0	0	12,583	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	12,583
1969	0	0	0	0	0	0	0	0	14,724	0	0	3,585	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	18,309
1970	0	0	0	0	0	0	0	0	6,341	0	0	300	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	6,641
1971	0	0	0	0	0	0	0	0	32,242	0	0	3,151	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	35,393
1972	0	0	0	0	0	0	295	0	52,834	0	0	2,709	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	55,838
1973	0	0	0	0	0	0	12,651	0	11,479	0	0	884	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	25,014
1974	0	0	0	0	0	0	0	0	4,234	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	4,234
1975	0	0	0	0	0	0	0	0	4,383	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	4,383
1976	0	0	0	0	0	0	11,739	0	9,852	0	1,933	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	23,524
1977	0	0	0	0	0	0	1,260	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1,260
1978	0	0	0	0	0	0	2,475	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2,475
1980	0	0	0	0	0	0	914	0	0	0	671	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1,585
1981	0	0	223	0	0	0	4,197	0	165	0	0	0	0	0	200	1,072	0	0	0	0	0	0	0	0	0	0	0	0	5,857
1982	0	0	0	0	0	0	2,548	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2,548
1983	0	0	0	0	0	0	4,817	2,574	290	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	7,681
1984	0	0	0	0	0	0	1,247	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1,247
1985	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	526	0	2,205	0	1,051	0	0	0	0	0	3,782
1986	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	631	0	649	0	0	0	0	0	1,280



	6	8								10			12		15		16			18		21	22	24			30	Total
	Victorized Clay Pipe	C-900 POLYVINYL CHLORIDE PIPE	CAST IRON PIPE	Concrete Pipe (non-reinforced)	CURED IN PLACE PIPE	Ductile Iron Pipe	Polyvinyl Chloride	SLIPLINED VITRIFIED CLAY PIPE	Victorized Clay Pipe	CURED IN PLACE PIPE	Polyvinyl Chloride	Victorized Clay Pipe	CURED IN PLACE PIPE	Victorized Clay Pipe	Concrete Pipe (non-reinforced)	Polyvinyl Chloride	POLYETHYLENE PIPE	Polyvinyl Chloride	SLIPLINED REINFORCED CONCRETE PIPE	CURED IN PLACE PIPE	SLIPLINED REINFORCED CONCRETE PIPE	CURED IN PLACE PIPE	SLIPLINED REINFORCED CONCRETE PIPE	CURED IN PLACE PIPE	Polyvinyl Chloride	SLIPLINED REINFORCED CONCRETE PIPE	SPRITLET POLYETHYLENE PIPE	
<b>Total</b>	150	506	223	215	28,354	84	83,093	2,574	229,011	4,307	2,708	17,542	900	950	200	3,452	746	293	2,698	4,803	4,928	1,313	4,195	4,007	50	3,712	186	401,200